



Anti-static handling guidelines

Make sure that electrostatic handling precautions are taken immediately before handling PCBs and other static sensitive components.

Before handling any static-sensitive items, operators should get rid of any electrostatic charge by touching a sound safety earth. Always handle PCBs by their sides and avoid touching any components.

1 Installation



1.1 Mounting The Unit

The Phone plate can be removed from the back box by removing the four screws marked A in the diagram on the right and lifting the bracket up.

The phone can be removed by unclipping the grey connector at the hook switch end of the cable.

The back box can now be prepared for the cable from the EVC System, this is a 2 core 1.5mm CSA Enhanced fire rated cable.



Knock out the cable knock out and gland the cable to the top right of the box, or if you are coming in from the rear drill where shown in dotted lines below (this is the only place clear of all operational parts of the outstation) a rubber grommet or gland should be used to protect the cable

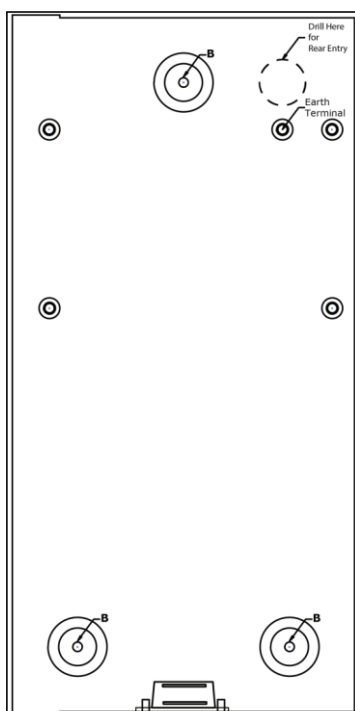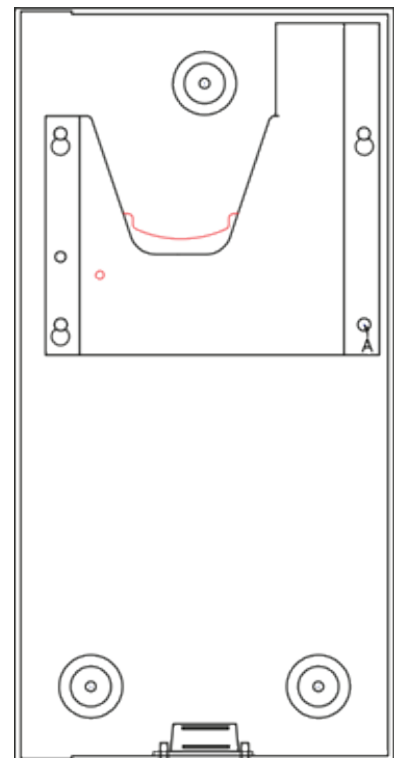

The Back box can now be mounted by using the holes marked B, the height of the unit needs to be 1300 to 1400mm from finished floor level to the centre of the outstation (as shown below)

If flush mounting using the BTAR bezel, the unit wants fitting to a maximum depth of 95mm for correct opening of the door.

The bezel is attached to the wall using clear bathroom sealer.

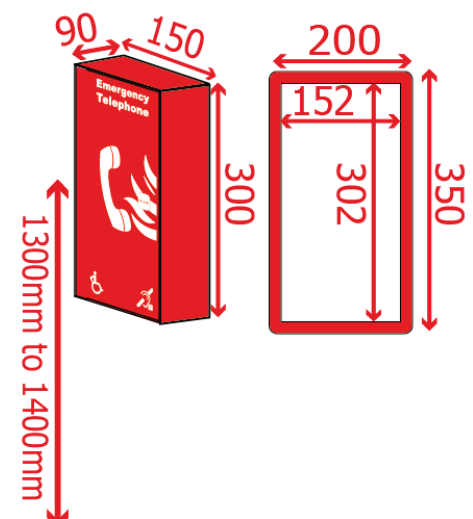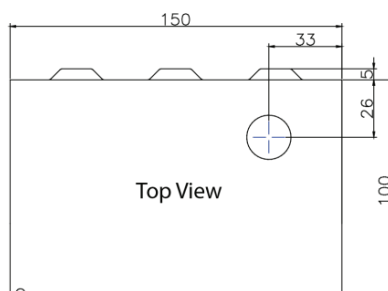

1.2 Connections


The 2 core Enhanced cable should be connected to the Line + and – terminals as shown (the connector is a two part one so it can be removed and terminated before being plugged onto the board).

The Earth should be connected to the Earth terminal in the back box.

The end of line is fitted internally so is not required for correct operation and monitoring.

The phone plate can be reassembled, and the phone plugged into the grey connector (care should be taken when plugging this in to ensure it is the correct way round)

When the phone is correctly wired the confidence LED lights dimly when the phone is on hook.

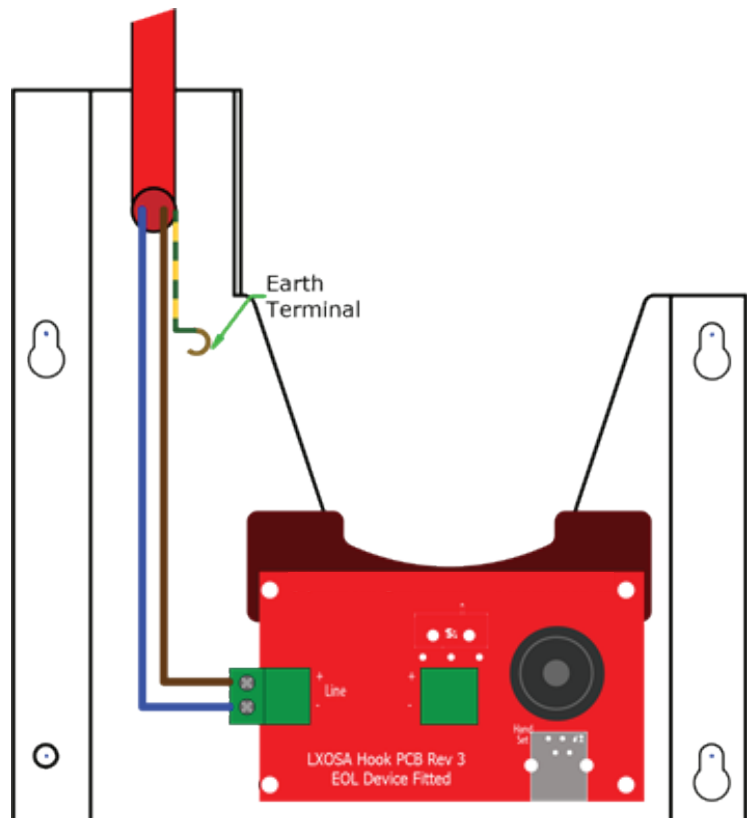

2 Operation

To call from the Type A phone simply remove the phone from the hook switch, this will cause all masters programmed for this line to ring. The call can be ended by placing the phone back on the hook switch (the confidence LED also lights again)

When the master calls the Type A outstation, the ringer sounds and the confidence LED flashes, to answer the phone remove the handset from the cradle and speech can take place- To end simply place the phone on the hook switch.

3 Maintenance

It is a requirement of BS 5839-9:2021 that a maintenance agreement be in place for the EVCS. The maintenance schedule should be as follows:

Frequency	Test
Weekly	Each week test one type A outstation (a different one each week) and ensure speech is clear and intelligible. Ring the outstation to verify the operation of the ringer. Record this in the log book for the EVCS.
6 Monthly	Every outstation on the system should be tested and the results logged in the logbook.



●●●●● ScolmoreGROUP

Elite Security Products UK, Unit 7 Target Park, Shawbank Road, Lakeside, Redditch, Worcestershire, B98 8YN
 Tel +44(0)1527 515 150, Fax +44(0)1527 150 143; Email info@espu.com
 Registered in England Number Company Registration No: 02769392, VAT Registration GB614686525
 For more product information please visit www.espu.com
 E&OE - Errors and omissions excepted.K21